


NOT TO SCALE

NOTE: USE GATE VALVES FOR PIPES 12" AND SMALLER. USE BUTTERFLY VALVES FOR PIPES LARGER THAN 12".

HANDWHEEL

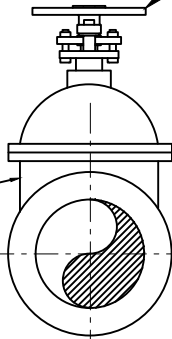


C509 RESILIENT WEDGE GATE VALVE
MUELLER A-2362, 350 PSI
GATE VALVE W/ HANDWHEEL
OR APPROVED EQUAL

ABOVE GROUND GATE VALVE APPLICATIONS

NOT TO SCALE

2" WRENCH NUT

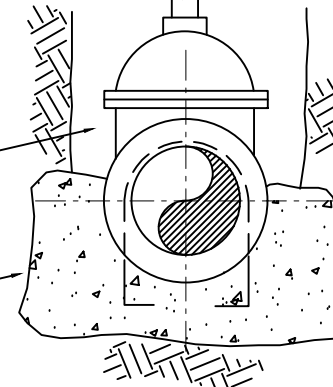


C509 RESILIENT WEDGE GATE VALVE
MUELLER A-2362, 350 PSI
GATE VALVE W/ 2" WRENCH NUT
OR APPROVED EQUAL

SEE THRUST BLOCK
STANDARD DETAIL

BURIED GATE VALVE APPLICATIONS

NOT TO SCALE

HANDWHEEL

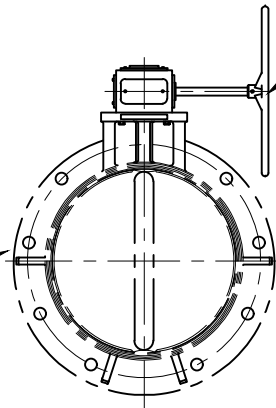


C504 RESILIENT BUTTERFLY VALVE,
MUELLER LINESEAL III,
CLASS 150 W/ MANUAL
HAND WHEEL OR
APPROVED EQUAL

ABOVE GROUND BUTTERFLY VALVE APPLICATIONS

NOT TO SCALE

2" WRENCH NUT

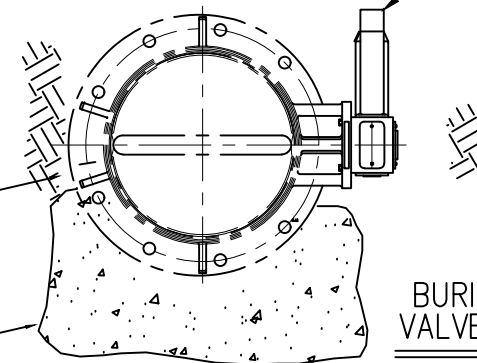

C504 RESILIENT BUTTERFLY VALVE,
MUELLER LINESEAL III,
CLASS 150 W/ 2" WRENCH
NUT OR APPROVED EQUAL

SEE THRUST BLOCK
STANDARD DETAIL

BURIED BUTTERFLY VALVE APPLICATIONS

NOT TO SCALE

APPROVED BY:

Tom Coleman
TOM COLEMAN
GENERAL MANAGER
07/07/2023
DATE



DRAWING #
W-12
REVISION DATE:
JUNE
2023

ROWLAND WATER DISTRICT

GATE AND BUTTERFLY
VALVE STANDARD DETAIL